

PART E

Special Requirements for Mounded Systems

Part E is supplemental requirements per the Rules and Regulations for Small Wastewater Permits in Sheridan County for dosing and mounded systems. Please reference **Section 26 . Subsurface Treatment and Disposal Systems** of the Rules and Regulations for Small Wastewater Permits in Sheridan County. Part E shall be filled out and submitted with the Small Wastewater Application Package when a dosing system and/or a mounded system is planned.

Dosing System

Pump Information:

Manufacturer: _____ Model: _____

Capacity (gpm): _____

Pump Tank Information:

Manufacturer: _____ Model: _____

Volume: (gallons) _____

Dosing Pipe Information:

Diameter: _____ Hole size: _____ Hole spacing: _____

Electrical Control Settings:

Pump "On" to Pump "Off" volume (gallons) _____

Pump "On" to Alarm volume (gallons) _____

Alarm to Tank inlet (gallons) _____

Percolation information

Percolation Rate of imported Material (mpi) _____


Was percolation test performed on imported material ? _____

If No, how was Percolation Rate determined? _____

Percolation Rate of native soil (mpi) from Percolation Test sheet _____

PART E

Standard Mound System Detail

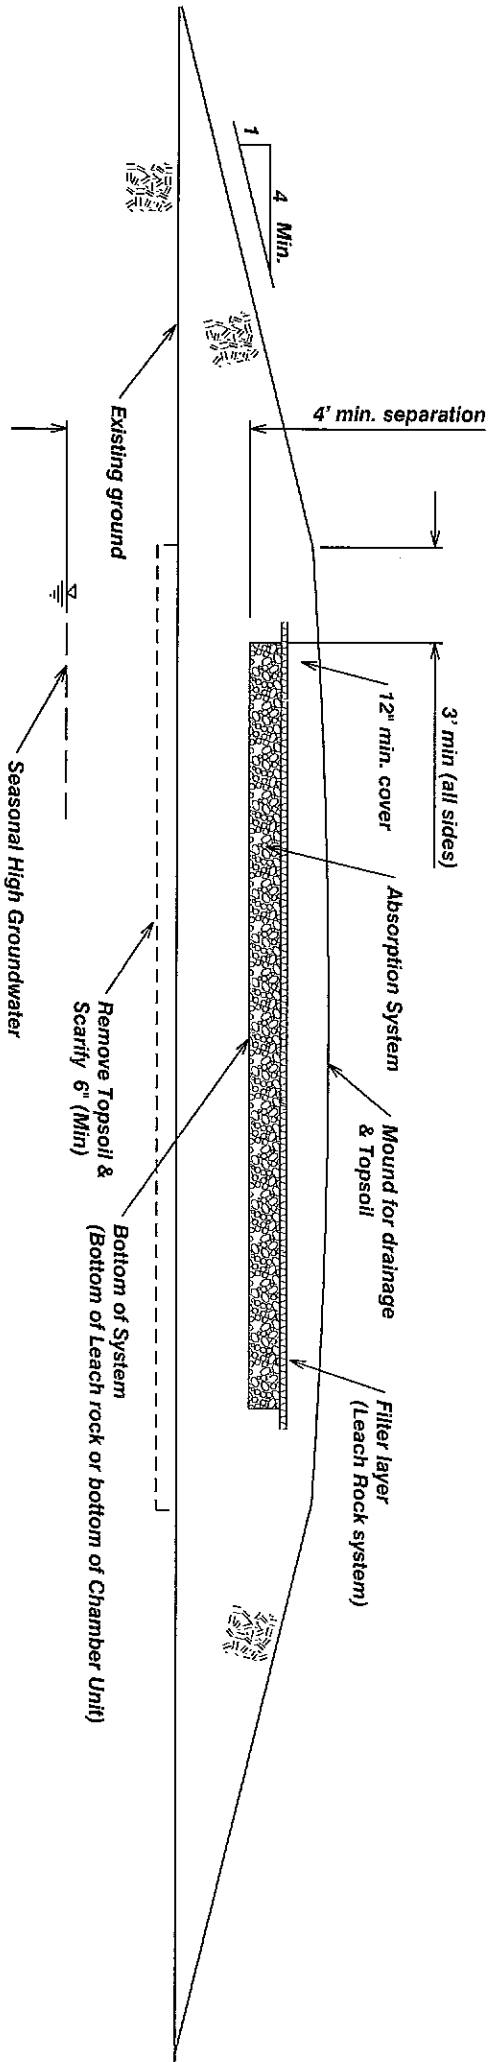

Cross-Section